SOLID STATE OPTRONICS

TD3083

Zero-Volt Switching
Triac Driver

RoHS compliant

DESCRIPTION

The TD3083 consists of a single input LED optically coupled to a zero-volt crossing triac driver. The TD3063 provides high input-to-output isolation and is designed to drive high-powered triacs. Typical uses include interfacing logic level control signals to equipment powered from AC lines rated at 240Vand higher.

FEATURES

- Zero-volt switching
- 800V blocking voltage
- High input-to-output isolation (5kV)
- Low trigger current (5mA MAX)
- High reliability

APPLICATIONS

- Home appliances
- Motor/ Drive controls
- Solid state relays
- Solenoid / Valve control
- Temperature Control

OPTIONS/SUFFIXES*

- -S Surface Mount Leadform Option
- -TR Tape and Reel Option
- -V Signifies VDE approval
- -H 0.4" Lead Spacing (see mechanical dimension)

NOTE: Suffixes listed above are not included in marking on device for part number identification.

SCHEMATIC DIAGRAM

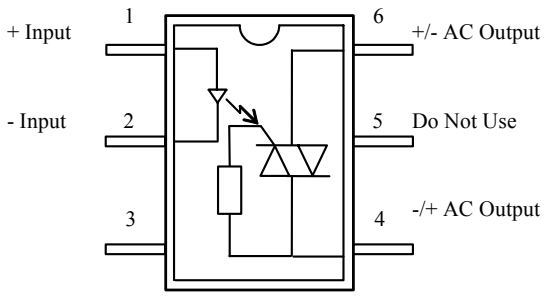

ABSOLUTE MAXIMUM RATINGS*

PARAMETER	UNIT	MIN	TYP	MAX
Storage Temperature	°C	-55		125
Operating Temperature	°C	-40		85
Continuous Input Current	mA			50
Transient Input Current	mA			400
Reverse Input Control Voltage	V			6
Total Power Dissipation	mW			330
Soldering Temperature (10s)	ºC			260

*The values indicated are absolute stress ratings. Functional operation of the device is not implied at these or any conditions in excess of those defined in electrical characteristics section of this document. Exposure to Absolute Ratings may cause permanent damage to the device and may adversely affect reliability.

APPROVALS

- UL and C-UL Approved File # E201932
- VDE Approved, Lic # 40011225

www.ssousa.com • +1.408.293.4600

ELECTRICAL CHARACTERISTICS - 25°C

PARAMETER	UNIT	MIN	TYP	MAX	TEST CONDITIONS
INPUT SPECIFICATIONS					
LED Forward Voltage	V		1.2	1.5	If = 10mA
LED Reverse Voltage	V	6	12		Ir = 10uA
Reverse Leakage Current	μ A			10	Vr = 4V
OUTPUT SPECIFICATIONS					
Blocking Voltage	V	800			Io = 1uA
Peak Blocking Current	n A		60	500	Vdrm = Rated
On-state Voltage	V		1.8	3	Itm = 100mA
Critical Rate of Rise	V / μ s	600			
COUPLED SPECIFICATIONS					
Isolation Voltage	V	5000			T = 1 minute
Trigger Current (See Note 1 below)	m A			5	Main terminal voltage = 3V
Inhibit Voltage	V		5	20	If = 5mA
Isolation Resistance	G Ω	50			DC 500V
Holding Current	μ A		100		
Leakage Current	μ A			1	If = Rated, Vdrm = Rated, Off State

Note 1: Resistive load. For inductive loads, higher drive current is recommended

STATIC dV/dt TEST CIRCUIT

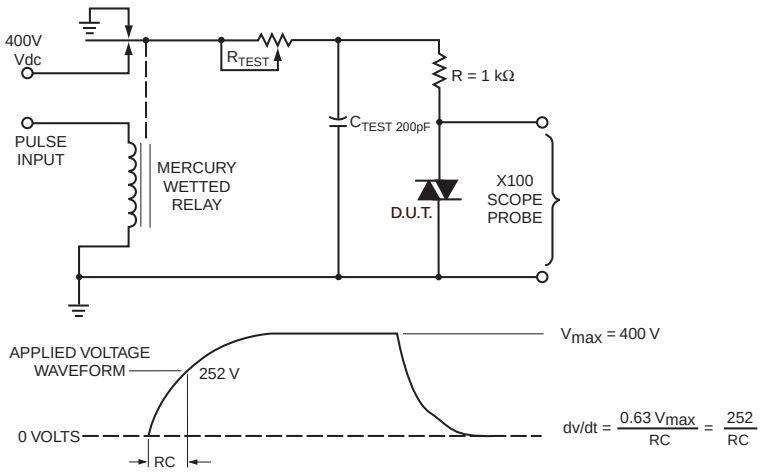

PERFORMANCE DATA

Fig.1 On-State Characteristics

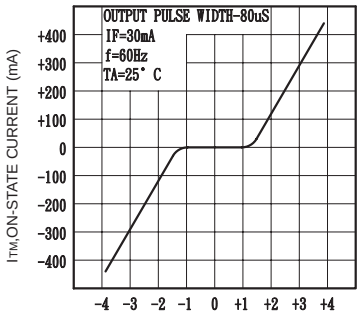

Fig.2 Inhibit Voltage versus Temperature

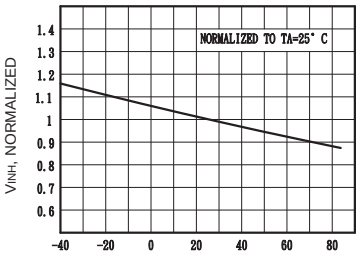

Fig.3 Leakage with LED Off versus Temperature

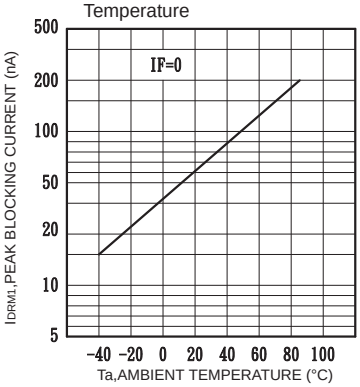

Fig.4 I_{DRM2} ,Leakage in Inhibit State versus Temperature

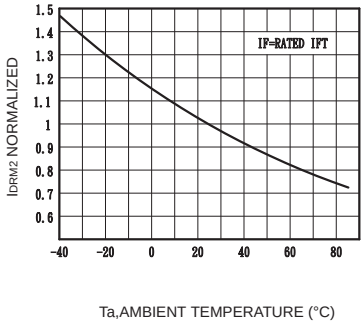

Fig.5 Trigger Current versus Temperature

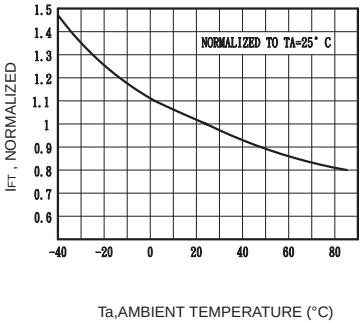

MECHANICAL DIMENSIONS

6 PIN DUAL IN-LINE PACKAGE (Through Hole)

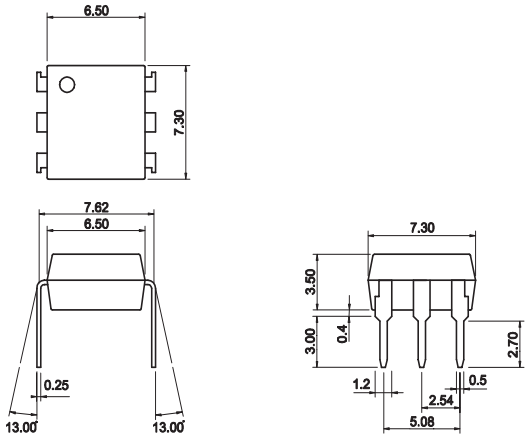

6 PIN SURFACE MOUNT DEVICE (SMD)

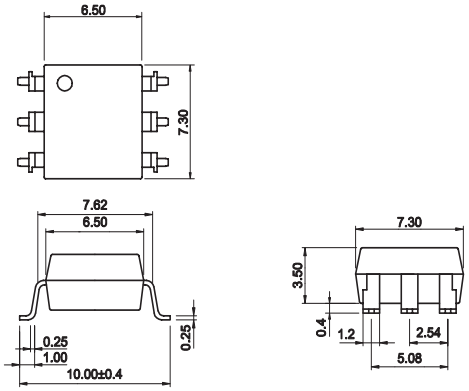

-H Suffix 0.4" Lead Spacing

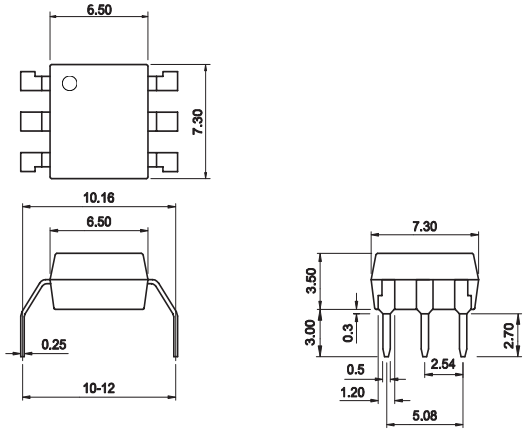

TOLERANCE :+ 0.25mm

Unit in (mm)

DISCLAIMER

Solid State Optronics (SSO) makes no warranties or representations with regards to the completeness and accuracy of this document. SSO reserves the right to make changes to product description, specifications at any time without further notice.
SSO shall not assume any liability arising out of the application or use of any product or circuit described herein. Neither circuit patent licenses nor indemnity are expressed or implied.
Except as specified in SSO's Standard Terms & Conditions, SSO disclaims liability for consequential or other damage, and we make no other warranty, expressed or implied, including merchantability and fitness for particular use.

LIFE SUPPORT POLICY

SSO does not authorize use of its devices in life support applications wherein failure or malfunction of a device may lead to personal injury or death. Users of SSO devices in life support applications assume all risks of such use and agree to indemnify SSO against any and all damages resulting from such use. Life support devices are defined as devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when used properly in accordance with instructions for use can be reasonably expected to result in significant injury to the user, or (d) a critical component in any component of a life support device or system whose failure can be reasonably expected to cause failure of the life support device or system, or to affect its safety or effectiveness.