

Model / type PFSX

Technical data

Measuring ranges	0...1 to 0...400 bar
Pressure type	Relativ, absolute
Display	-1999 to 9999 points 4 red LED digits (8mm high)
Threshold adjustment range	From 2% to 98% of FS
Response time	≤20ms
Accuracy (20°C)	± 0.5% FS (linearity, hysteresis, repeatability)
Pressure connection	G1/4 EN 837, G1/2 EN 837, G1/4 DIN 3852

Environment

Temperature	
Storage	-40...+85 °C
Fluids	-25...+100 °C
ATEX model	-25...+70 °C -25 °C ≤ Ta ≤ +40°C, T6 or T80°C -25 °C ≤ Ta ≤ +70°C, T5 or T95°C
Others	-25 °C...+85 °C
Thermal drift	± 0.015 % EM/°C max
Protection class (EN60529)	IP65 and IP67
Vibration resistance (EN 600068-2-6)	1.5 mm (10Hz...55Hz) / 20g (55Hz ...2kHz)
Shock resistance (EN 600028-2-32)	25 drops from 1m on a concrete floor

Materials

Pressure connections	Stainless steel AISI 316L (1.4404)
Sensor	Ceramic
Sealing	NBR gasket standard, EPDM, FKM (viton®)
Horsing	Stainless steel 1.4404 (316L)

Approvals

CE conformity	EMC directive 2004/108/CE Pressure directive 97/23/CE ATEX directive 94/9/CE
SIL	2 according to CEI 61508

SIL2 is assessed for the PFSX alone, used as recommended in the Safety Manual. Mounting on a chemical seal or other accessories leads to a change in failure rates. In this case, the user is responsible for checking the SIL rating.

Electrical characteristics

To ensure safety, the PFSX must be connected via a shielded cable supplied by Baumer as an option (codes 0607, 0608 or 0609).

Supply voltage	11-28 Vdc, non-regulated against polarity reversal
Consumption	50mA max
Load impedance	Rc ≤ 400 Ω
Output signal	4-20 mA (3-wire)
Threshold outputs	
ATEX model	40mA under 28Vdc solid state relays
Others	400mA under 24Vac 50Hz or 40Vdc solid state relays
Electric connection	M12-8 male contacts connector

Options

Use on drinking water	Code 0619
Use on oxygen	Code 0765
Specific cleaning (use on gas)	Code 0829
Ø10mm hole in connection (for G1/2 connectors)	Code 9022

Measuring Ranges

F.S.	-1 +0	-1 +0,6	-1 +1,5	-1 +3	-1 +5	-1 +9	-1 +15	-1 +24	-1 +39
Permissible overpressure	3	3	4	8	12	20	32	50	80
Burst pressure	6	6	7	12	18	30	48	75	120
Display of the FS	-1.000 / 0	-1.000 / 0.600	-1.000 / 1.500	-1.000 / 3.000	-1.000 / 5.000	-1.000 / 9.000	-1.00 / 15.00	-1.00 / 24.00	-1.00 / 39.00

F.S.	0 +1	0 +1,6	0 +2,5	0 +4	0 +6	0 +10	0 +16	0 +25	0 +40	0 +60	0 +100	0 +160	0 +250	0 +400
Permissible overpressure	3	3	4	8	12	20	32	50	80	120	200	320	500	600
Burst pressure	7	7	7	12	18	30	48	75	120	180	300	480	600	800
Display of the FS.	0 / 1.000	0 / 1.600	0 / 2.500	0 / 4.000	0 / 6.000	0 / 10.00	0 / 16.00	0 / 25.00	0 / 40.00	0 / 60.00	0 / 100.0	0 / 160.0	0 / 250.0	0 / 400.0

Parameter configuration and display

Parameter configuration mode

The three buttons on the front configure the following operating parameters:

- Switching point value for each threshold
- Switch-over hysteresis value for each threshold
- Active state of each threshold: (NO or NC)
- Switch-over delay from 0 sec to 25 sec by 0.1 sec steps
- Auto-zero function
- Parameter self-checking and protection by 4-digit code

Parameter display mode

It is possible to display the configured parameters for each threshold without entering access code

Display of maximum and minimum values


With the pressure switch in measuring mode, it is possible at any time to display or initialise any max and min pressure values saved since operation start..

Auto-diagnostic information display


Warning messages can be displayed whilst the pressure switch is operational (see safety manual and instruction note).

Model / type PFSX

Dimensions and connection

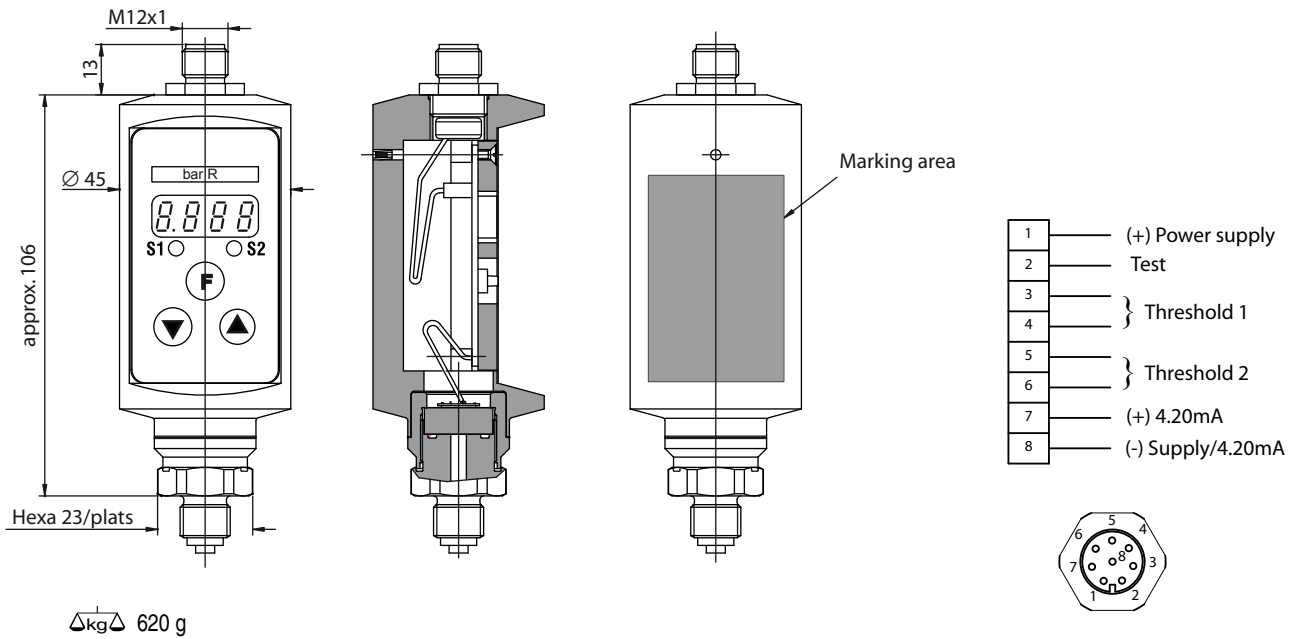

Pressure connections

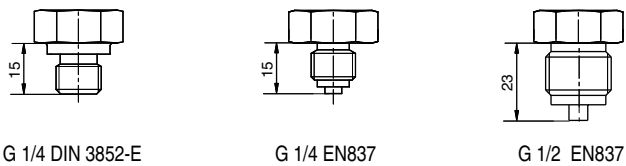

Accessories

Type	Description	Code
	Moulded screened cable M12-8 pin. Length 2 m	0607
	Moulded screened cable M12-8 pin. Length 5 m	0608
	Moulded screened cable M12-8 pin. Length 10 m	0609
	Moulded screened cable M12-8 pin. Length 20 m	0595

Important: The cable shield assures the earthing of the PFSX.


Setting up ATEX

Electrical parameters for PFSX for ia, iaD and tD

Terminals 1 and 8	$U_i \leq 28V$ $L_i \leq 5.5\mu H$	$I_i \leq 120mA$ $C_i \leq 72nF$	$P_i \leq 0.8W$
Terminal 2	$U_i \leq 30V$ $L_i \approx 0$	$I_i \leq 3mA$ $C_i \approx 0$	$P_i \leq 0.05W$
Terminals 3 and 4, 5 and 6	$U_i \leq 30V$ $L_i \approx 0$	$I_i \leq 50mA$ $C_i \approx 0$	$P_i \leq 0.37W$
Terminals 7 and 8	$U_o \leq 6V$ $I_o \leq 120mA$	$P_o \leq 0.180W$	

In area 0 or 20, the loop calculation of the association transmitter with safety barrier must be approved by notified organism.

SIL2 barriers recommended

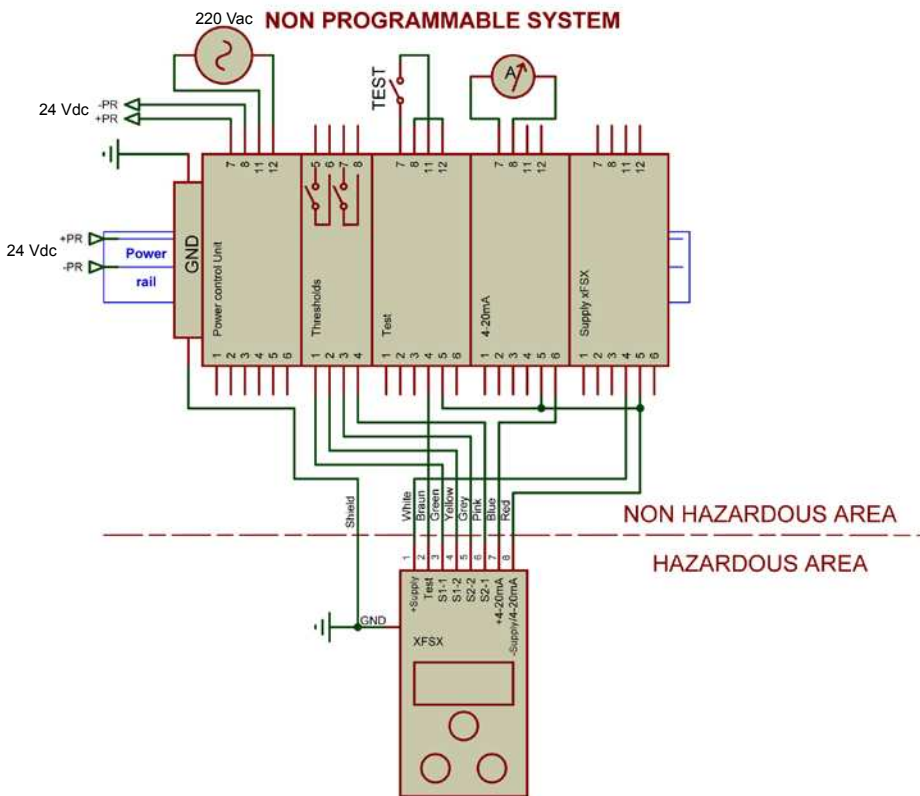

Modules	Non programmable system code
Supply 24 Vdc	11079100 Input : 115/230 Vac Output : 24 Vdc, 500 mA
Power rail supply	
Power rail (DIN 32 mm)	11079079
Grounding terminal block (GND)	11079071
Power control unit	
Supply xFSx	11079078
Test	11079077
4-20 mA	11079076
Thresholds 1 and 2	11079074

